


66. 02-04-2009 18:58:17

Grenaa
 Nordmolen

Information from dive computer

Other information

| | | | | | |
|-------------------|----------------------------|---|--------------------------|--------------------------|----------------------|
| Dive no. | 66 | Weather | Clear Sky / Night | Dive manually added | No |
| Start time | 02-04-2009 18:58:17 | Visibility | 3-5 M | Tissue pressures invalid | No |
| End time | 02-04-2009 19:40:17 | Weight used | 12 kg | Cylinder size | 15 liters |
| Dive time | 00:42:00 | Temperatures | | Working pressure | 300 bar |
| Max depth | 5.9 m | Start of dive | 6 °C | Cylinder pressure | |
| DC Dive no. | 3 | Max depth | 6 °C | Start | 180 bar |
| Surface Interval | 44:34:00 | End of dive | 6 °C | End | 60 bar |
| ID no. | 72101106 | Buddy | Martin Møller | Average depth | 3,2 m |
| Personal info | knuspar@knuspar.dk | Boat name | | SAC Rate | 31 SLM |
| Model | D6 | Dive Master | | Air used | |
| Sampling Rate | 1 sec | Custom 1 | | Pressure used | 120 bar |
| Altitude mode | A0 | Custom 2 | | Rate used | 2,9 bar/min |
| Personal settings | P0 | Custom 3 | | Volume gas used | 1716,4 liters |
| Dive type | Gauge | Custom 4 | | | |
| Alarms Recorded | 22 | Custom 5 | | | |
| Oxygen Percent | 32% 35% | Dive gear | | | |
| OLF | | Rented Regulator+Octopus, Treble Light 50W HID, Sporasub Instinctcell 6,5mm Freediving Suit, Rented BCD | | | |

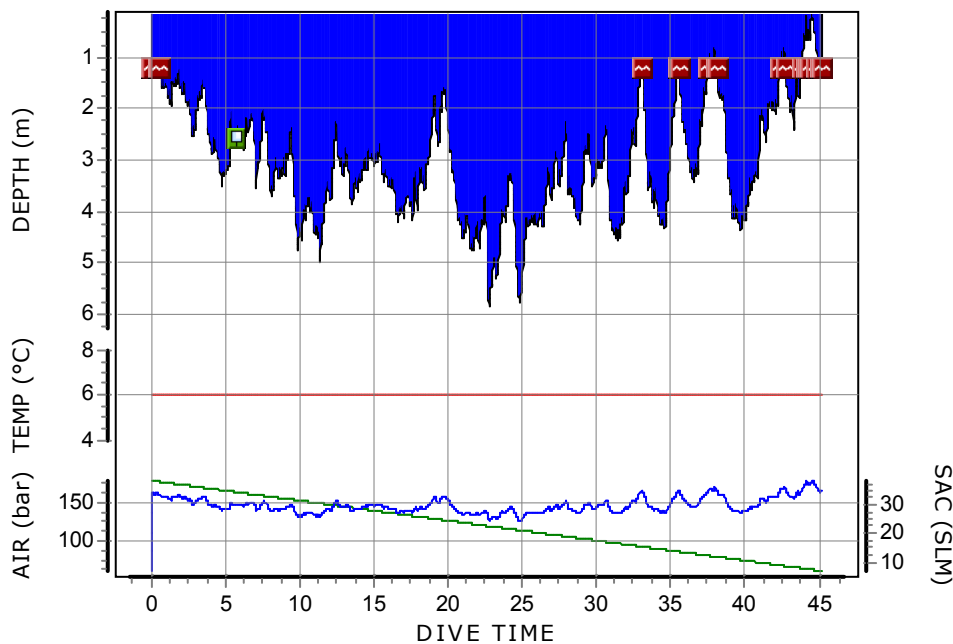

Tissue saturation on start



Tissue saturation on end



Notes

Dived on gauge mode since i had a free dive ~44 hours ahead of it.

Dove on regular air (21% O2 and 79% nitrogen)

Verly cold dive =)